





SEL 246 B
012900405




SEL 246 CM
012900406

- ISTRUZIONI DI INSTALLAZIONE E UTILIZZO -
- INSTALLATION AND APPLICATION INSTRUCTIONS -
- INSTRUCTIONS D' INSTALLATION ET D' UTILISATION -
- INSTALLATIONS- UND BEDIENTUNGSANLEITUNG -
- INSTRUCCIONES DE INSTALACIÓN Y EMPLEO -

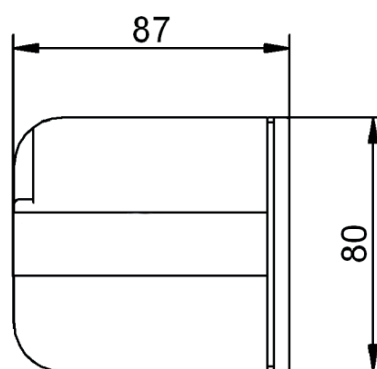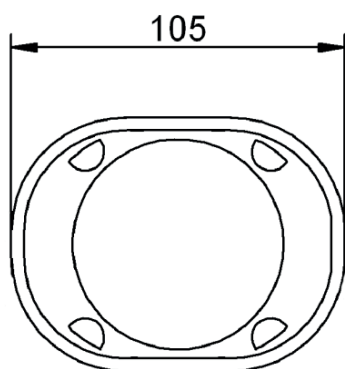

V	24 ---	24 $\sim$
mA	70	170

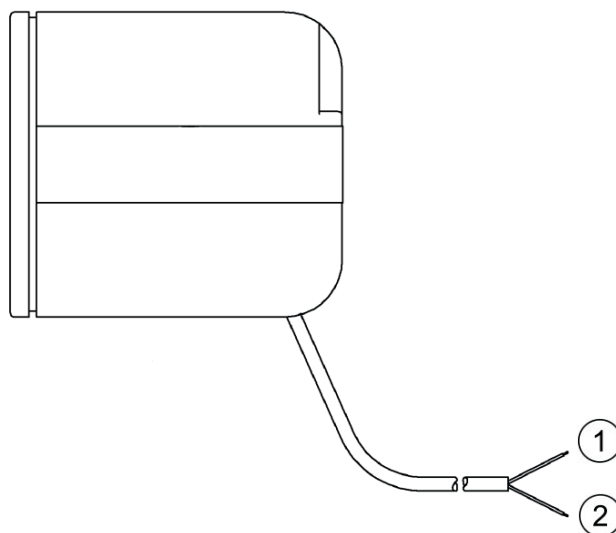




- ① = FILO MARRONE (POSITIVO DI ALIMENTAZIONE) - BROWN WIRE (POSITIVE POWER SUPPLY) - FIL MARRON (POSITIF D'ALIMENTATION) - BRAUN LEITUNG (SPANNUNGSPOSITIV) - CABLE MARRÓN (POSITIVO DE ALIMENTACIÓN)
- ② = FILO BLU (NEGATIVO DI ALIMENTAZIONE) - BLUE WIRE (NEGATIVE POWER SUPPLY) - FIL BLEU (NEGATIF D'ALIMENTATION) - BLAU LEITUNG (SPANNUNGSNEGATIV) - CABLE AZUL (NEGATIVO DE ALIMENTACIÓN)

NON SMALTIRE COME RIFIUTO URBANO - NOT TO BE DISPOSED OF AS COMMON WASTE - NE PAS ELIMINER COMME DECHET URBAIN - NICHT ÜBER DIE NORMALE SAMMLUNG VON HAUSMÜLL ENTSORGEN - NO ELIMINAR COMO DESECHO URBANO


L' INSTALLAZIONE DEVE ESSERE EFFETTUATA DA PERSONALE SPECIALIZZATO - INSTALLATION MUST BE CARRIED OUT BY QUALIFIED PERSONNEL - L' INSTALLATION DOIT ETRE EFFECTUEE PAR UN PERSONNEL SPECIALISE - DIE INSTALLATION IST VON EINER FACHKRAFT VORZUNEHMEN - LA INSTALACIÓN DEBERÁ REALIZARSE POR PERSONAL ESPECIALIZADO



ISTRUZIONI DI INSTALLAZIONE E UTILIZZO - INSTALLATION AND APPLICATION INSTRUCTIONS
INSTRUCTIONS D' INSTALLATION ET D' UTILISATION - INSTALLATIONS- UND BEDIENUNGSANLEITUNG
INSTRUCCIONES DE INSTALACIÓN Y EMPLEO

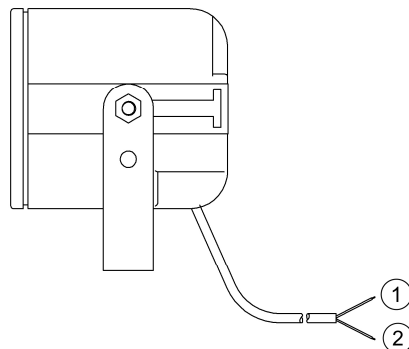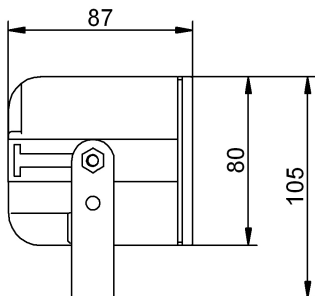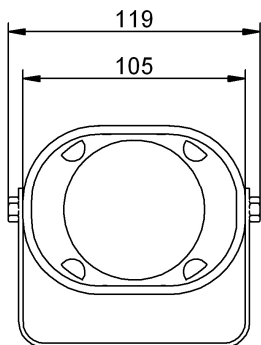

V	12
mA	320




- ① = FILO ROSSO (POSITIVO DI ALIMENTAZIONE) - RED WIRE (POSITIVE POWER SUPPLY)
FIL ROUGE (POSITIF D'ALIMENTATION) - ROTE LEITUNG (SPANNUNGSPOSITIV)
CABLE ROJO (POSITIVO DE ALIMENTACIÓN)
- ② = FILO NERO (NEGATIVO DI ALIMENTAZIONE) - BLACK WIRE (NEGATIVE POWER SUPPLY)
FIL NOIR (NEGATIF D'ALIMENTATION) - SCHWARZE LEITUNG (SPANNUNGSNEGATIV)
CABLE NEGRO (NEGATIVO DE ALIMENTACIÓN)

TABELLA SUONI SELEZIONABILI DA DIP-SWITCH - SOUND TABLE SELECTABLE BY DIP-SWITCH
TABLEAU SONORE SÉLECTIONNABLE PAR DIP-SWITCH - SOUND TABLE MIT DIP-SWITCH AUSWAHLBAR -
TABLA DE SONIDO SELECCIONABLE MEDIANTE DIP-SWITCH

N°	DIP-SWITCH						Sound	F(Hz) Times	dB(A) 1m
1	0	0	0	0	0	1	GENDARMERIA FRANCESE	F1 = 440 Hz; F2 = 738.5 Hz T1 ≡ T2 = 510 mS	106 dB(A)
2	1	0	0	0	0	1	(U.M.H.) - FRANCIA	F1 = 440 Hz; F2 = 660 Hz T1 ≡ T2 = 510 mS	106,5 dB(A)
3	0	1	0	0	0	1	SUONO BITONALE	F1 = 392 Hz; F2 = 523 Hz T1 ≡ T2 = 750 mS	105 dB(A)
4	1	1	0	0	0	1	POMPIERI AUSTRIA	F1 = 392 Hz; F2 = 523 Hz; F3 = 0 Hz T1 ≡ T2 = 750 mS T3 = 565 mS	105 dB(A)
5	0	0	1	0	0	1	POLIZIA AUSTRIA	F1 = 440 Hz; F2 = 587 Hz T1 = 340 mS; T2 = 510 mS T3 ≡ T4 ≡ T5 ≡ T6 = 340 mS T7 = 710 mS	105,5 dB(A)
6	1	0	1	0	0	1	POMPIERI FRANCIA	F1 = 440 Hz; F2 = 493 Hz T1 ≡ T2 = 1010 mS	105,5 dB(A)
7	0	1	1	0	0	1	POLIZIA FRANCIA	F1 = 440 Hz; F2 = 587 Hz T1 ≡ T2 = 510 mS	104,5 dB(A)
8	1	1	1	0	0	1	AMBULANZA PRIVATA FRANCIA	F1 = 415 Hz; F2 = 523 Hz; F3 = 0 Hz T1 ≡ T2 ≡ T3 = 165 mS T4 = 1500 mS	105 dB(A)
9	0	0	0	1	0	1	POLIZIA GERMANIA (DIN)	F1 = 440 Hz; F2 = 587 Hz T1 = 780 mS; T2 = 790 mS	105 dB(A)
10	1	1	0	1	0	1	POLIZIA ITALIA (DGM)	F1 = 466 Hz; F2 = 622 Hz T1 = 780 mS; T2 = 790 mS	106,5 dB(A)
11	0	0	1	1	0	1	AMBULANZA ITALIA (DGM)	F1 = 392 Hz; F2 = 660 Hz T1 = 1010 mS T2 ≡ T3 ≡ T4 = 165 mS	106 dB(A)

ON=1
OFF=0



NON SMALTIRE COME RIFIUTO URBANO - NOT TO BE DISPOSED OF AS COMMON WASTE - NE PAS ELIMINER COMME DECHET URBAIN
NICHT ÜBER DIE NORMALE SAMMLUNG VON HAUSMÜLL ENTSORGEN - NO ELIMINAR COMO DESECHO URBANO

- L' INSTALLAZIONE DEVE ESSERE EFFETTUATA DA PERSONALE SPECIALIZZATO - INSTALLATION MUST BE CARRIED OUT BY QUALIFIED PERSONNEL -
- L' INSTALLATION DOIT ETRE EFFECTUEE PAR UN PERSONNEL SPECIALISE - DIE INSTALLATION IST VON EINER FACHKRAFT VORZUNEHMEN -
- LA INSTALACIÓN DEBERÁ REALIZARSE POR PERSONAL ESPECIALIZADO -

